



LEGEND:

- ⊙ SD SMOKE DETECTOR GST
- ⊙ B SOUNDER AND BEACON
- ⊠ M MANUAL FULL STATION
- ⊠ FACP FIRE ALARM CONTROL PANEL 4 ZONE GST
- NUMBER OF T.F. WIRES IN CONDUIT

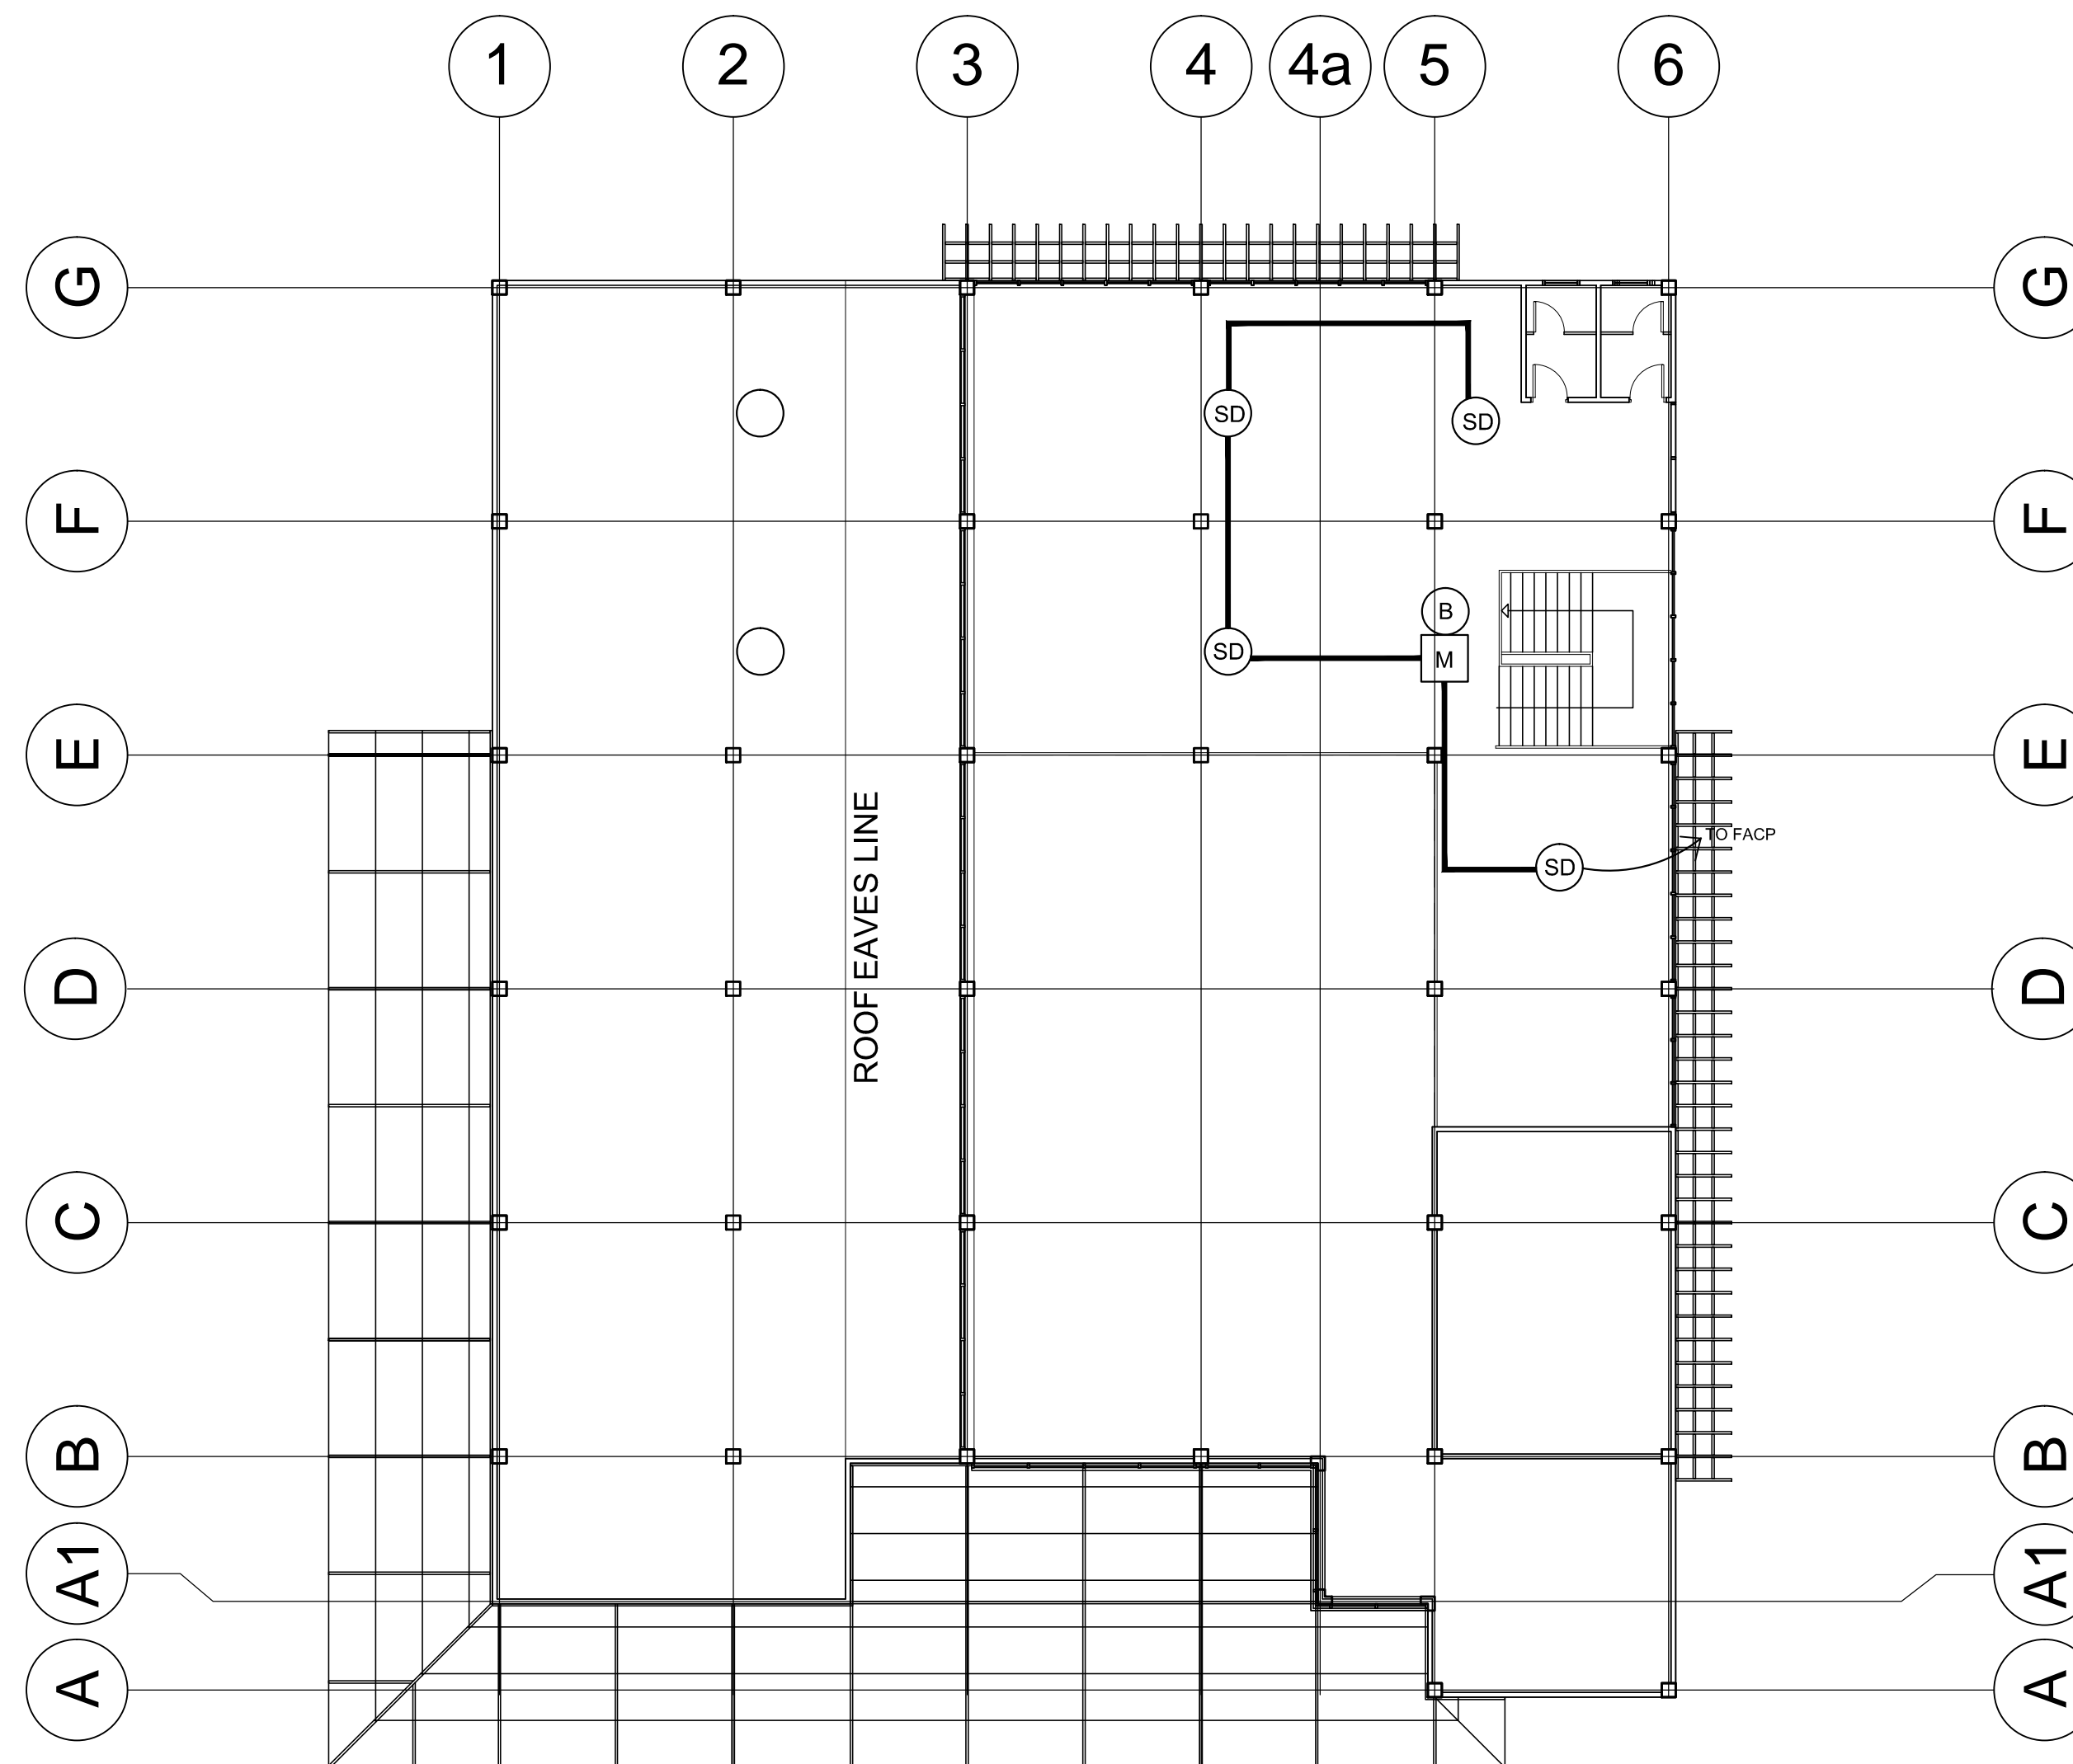

1
AUX 4

**MEZZANINE
FIRE DETECTION & ALARM SYSTEM**
 SCALE 1:150 MTS



ARCHITECT DANIEL M. BRIONES, UAP
 Diamond St., RGA Village Cabaguio Ave., Davao City
 Tel. Numbers: 221-6490 – 221-8693
 Telefax No.(082)221-1267

ARCHITECT	
DANIEL M. BRIONES	
PRC REG. NO. 7064	VALID UNTIL:
IAPOA NO.	ISSUED ON:
TIN 157 725 299	VALID UNTIL:

REPUBLIC ACT 9266 ARTICLE 4 SEC. 33
 Drawings & specifications and other contract documents duly signed & stamped or sealed as instruments of service, are the intellectual property and documents of the Architect, whether the object for which they are made is executed or not.
 It shall be unlawful for any person to duplicate or to make copies of said documents for use of repetition of and for other project or buildings, whether executed or not, without the written consent of the Architect of said documents.

PROFESSIONAL ELECTRICAL ENGINEER	
PROPOSED UP MINDANAO MAIN LIBRARY	
PROJECT LOCATION	
PEE REG. NO. --	VALID UNTIL: --
PTR NO. --	ISSUED ON: --
TIN --	ISSUED AT: --

UNIVERSITY OF THE PHILIPPINES MINDANAO
 MINTAL, TUGBOK DISTRICT, DAVAO CITY

NOTES AND REVISIONS	
AUTOCAD BY:	DATE:
REVISED BY:	DATE:
CHECKED BY:	DATE:

OWNER


UNIVERSITY OF THE PHILIPPINES MINDANAO
 DR. GILDA C. RIVERO
 Chancellor

SHEET CONTENTS

SECOND FLOOR FIRE
DETECTION & ALARM SYSTEM

SHEET NO.

AUX
4 6